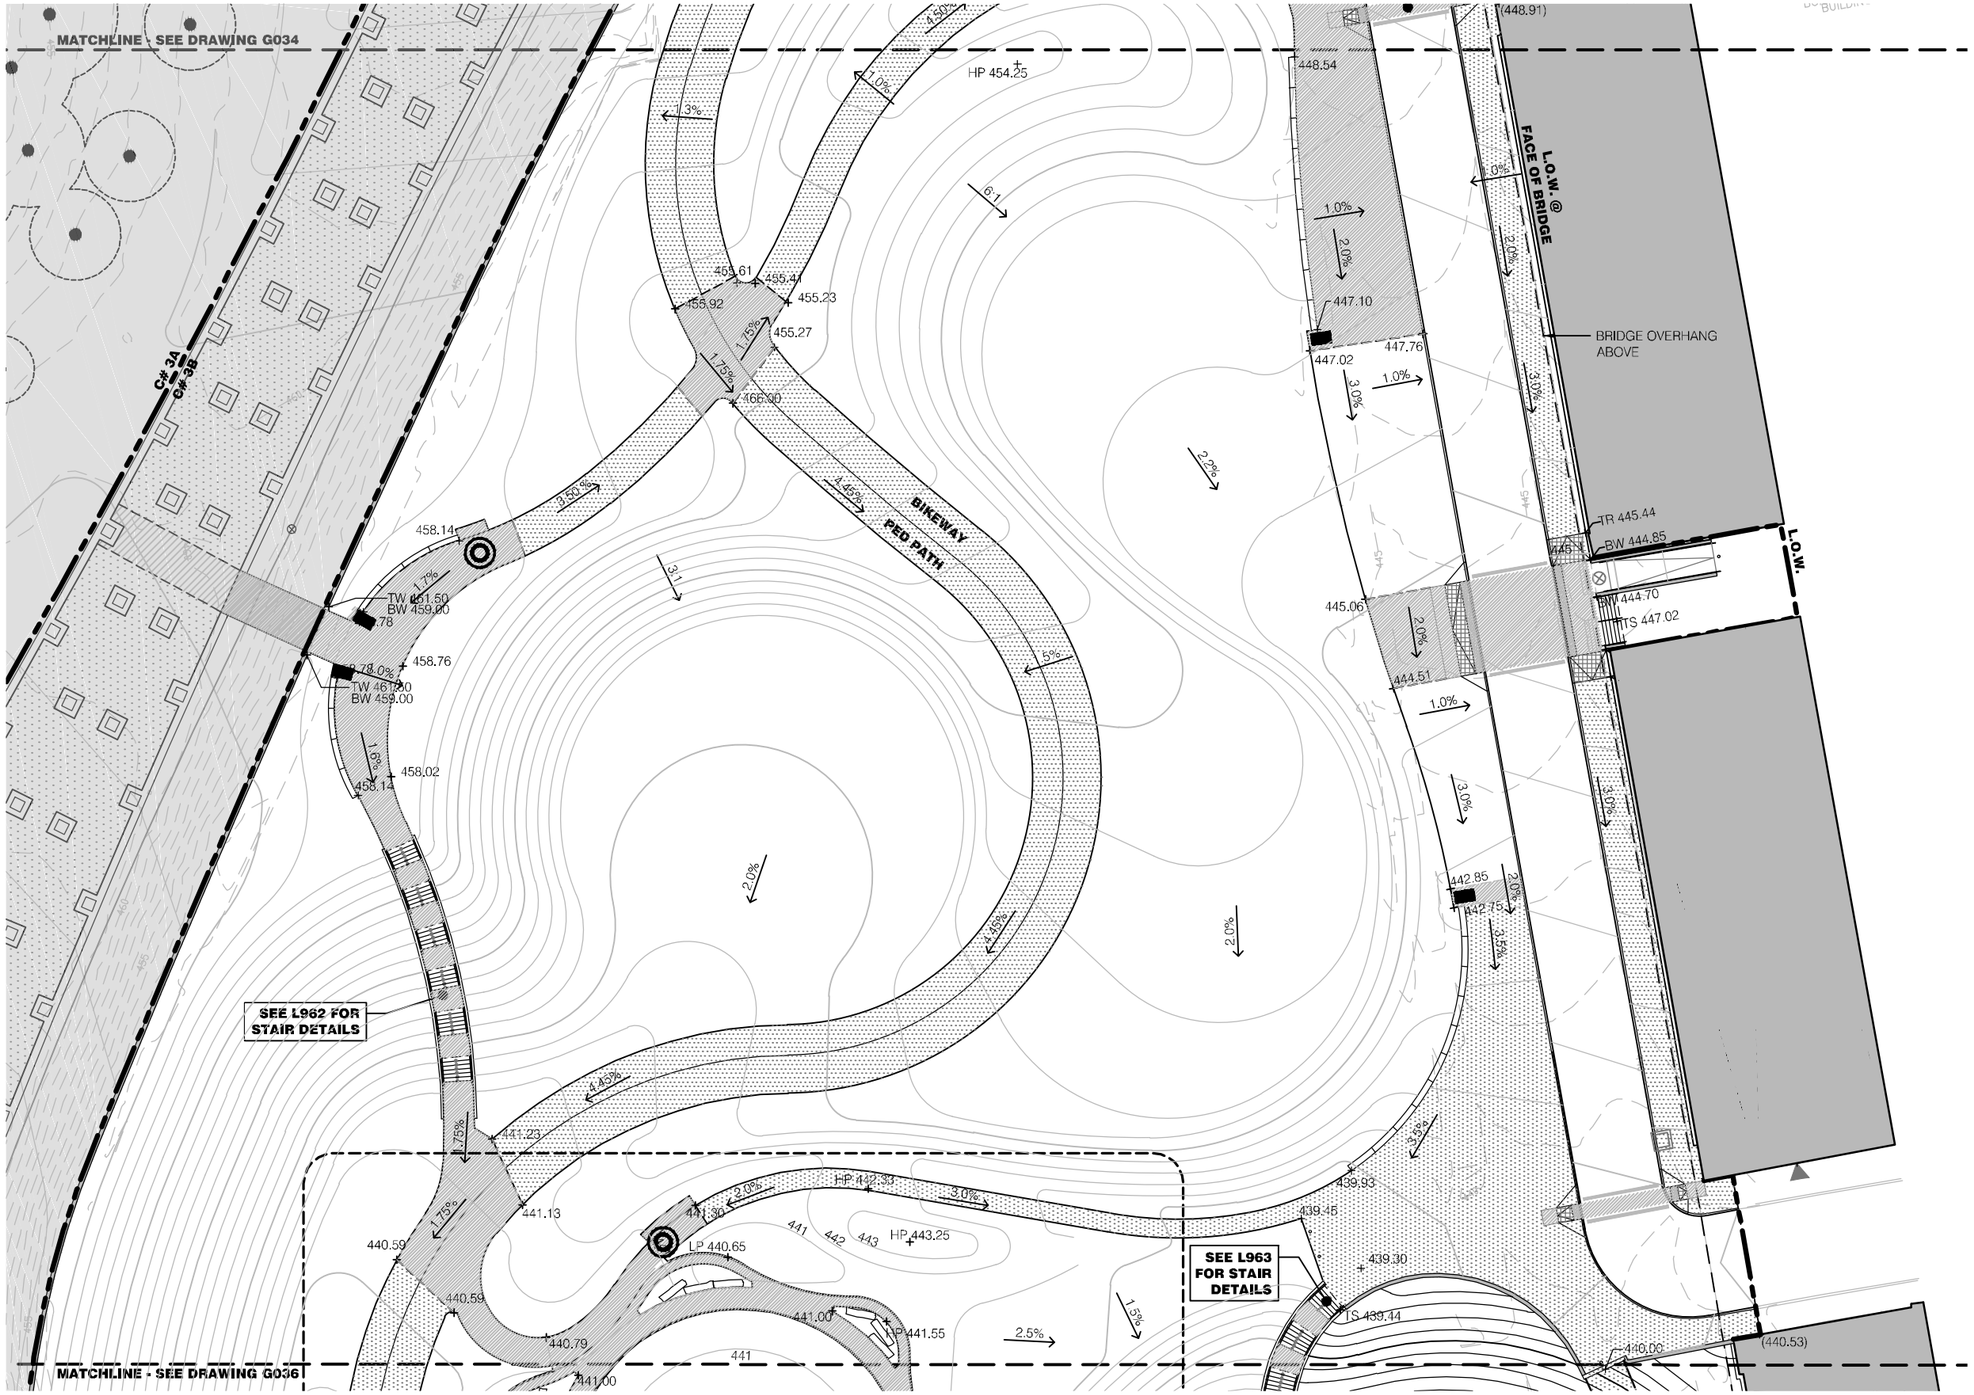

ACCESSIBILITY LEGEND

- MAXIMUM 2% SLOPE IN ANY DIRECTION
- MAXIMUM 5% RUNNING SLOPE WITH MAXIMUM 2% CROSS SLOPE
- RAMP WITH MAXIMUM 1:12 RUNNING SLOPE WITH MAXIMUM 2% CROSS SLOPE
- SLOPE TRANSITION
- INTEGRATED WHEEL CHAIR SEAT WITH COMPANION SEAT
- WHEEL CHAIR TURNING SPACE AT DRINKING FOUNTAIN

L.O.W. — LIMIT OF WORK

MATCHLINE

STRUCTURE BELOW

STRUCTURE ABOVE

ACCESSIBILITY NOTES:

1. THE MAXIMUM CROSS SLOPE FOR ALL SIDEWALKS IS 2% AND THE MAXIMUM CROSS SLOPE FOR RAMPS IS 1%.
2. NO TOLERANCES ARE ALLOWED FOR THE GRADING OF ACCESSIBLE CURB RAMPS. RAMPS MUST MEET ABAAS.
3. SLOPES WILL BE MEASURED USING A 24" SMART LEVEL AND MUST MEET ABAAS AT ANY POINT IN THE ACCESSIBLE PAVEMENT.

NOTE:
CONTRACTOR SHALL NOTIFY CONTRACTING OFFICER OF ANY DISCREPANCIES WITH EXISTING OR PROPOSED ELEVATIONS SHOWN IN THESE PLANS PRIOR TO CONSTRUCTION.

20 0 20 40
SCALE OF FEET

N

SAMPLE ACCESSIBILITY PLAN - SITE

	TITLE OF SHEET **ACCESSIBILITY PLAN**	DRAWING NO. ——
		PMIS/PKG NO.
		SHEET ___ OF ___